

CLIENT: CRANE COMPOSITES
8015 Dixon Dr
Florence KY, 41042

Test Report No: TJ2056

Date: April 9, 2014

SAMPLE ID: The Client submitted and identified the following test material as “**FSQF .090.**”

SAMPLING DETAIL: Test samples were submitted to the laboratory directly by the client. No special sampling conditions or sample preparation were observed by QAI.

DATE OF RECEIPT: Samples were received at QAI facilities on March 31, 2014

TESTING PERIOD: April 3, 2014

AUTHORIZATION: Signed work order by Michelle Bauer

TEST REQUESTED: Perform standard flame spread and smoke density developed classification tests on the sample supplied by the Client in accordance with ASTM Designation E84-12, "Standard Method of Test for Surface Burning Characteristics of Building Materials". The foregoing test procedure is comparable to UL 723, ANSI/NFPA No. 255, and UBC No. 8-1.

| TEST RESULTS: | <u>Flame Spread</u> | <u>Smoke Developed</u> |
|----------------------|----------------------------|-------------------------------|
| | 50 | 350 |

CLASSIFICATION: The material tested resulted in a Class B. Detailed test results are presented in the subsequent pages of this report

Prepared By

**Signed for and on behalf of
QAI Laboratories, Inc.**



Jeff Foster
Fire Test Technician



J. Brian McDonald
Operations Manager



PREPARATION AND CONDITIONING: The sample was submitted in six panels that were 4 feet long measuring 24 inches wide and approximately .090 inch thick. The sample material was placed into conditioning at 73°F (±5°F) and 50% (±5%) relative humidity until day of testing.

E 84 TEST DATA SHEET:

MOUNTING METHOD: The sample was supported during testing by 2" hexagonal mesh poultry netting running the length of the test chamber and ¼" round metal rods placed at 2' intervals across the width of the test chamber, with cement board place between sample and tunnel lid.

CLIENT: CRANE COMPOSITES **DATE:** April 9, 2014

SAMPLE: FSQF.090

IGNITION: 0 minutes, 45 seconds

FLAME FRONT: 12 feet maximum

TIME TO MAXIMUM SPREAD: 3 minutes, 00 seconds

TEST DURATION: 10 minutes, 00 seconds

SUMMARY: FLAME SPREAD: 50 (50.6 unrounded) **SMOKE DEVELOPED:** 350 (335 unrounded)

OBSERVATIONS:

Audible crackling could be heard at 42 seconds into the test, followed by charring at 43 seconds and sustained ignition at 45 seconds. Significant flame spread up to window 12 early into test. After burn was witnessed at conclusion of the test.

CALIBRATION DATA:

| | |
|-----------------------------------------|-------|
| Time to Ignition of Last Red Oak (sec): | 57 |
| Red Oak Smoke Area (%A* Min): | 111 |
| Total Fuel Burned (ft ³) | 59.68 |



SUMMARY OF ASTM E84 RESULTS:



Because of the possible variations in reproducibility, the results are adjusted to the nearest figure divisible by 5. Smoke Density values over 200 are rounded to the nearest figure divisible by 50.

In order to obtain the Flame Spread Classification, the above results should be compared to the following table:

| <u>NFPA CLASS</u> | <u>IBC CLASS</u> | <u>FLAME SPREAD</u> | <u>SMOKE DEVELOPED</u> |
|-------------------|------------------|---------------------|---------------------------|
| A | A | 0 through 25 | Less than or equal to 450 |
| B | B | 26 through 75 | Less than or equal to 450 |
| C | C | 76 through 200 | Less than or equal to 450 |

BUILDING CODES CITED:

1. National Fire Protection Association, ANSI/NFPA No. 101, "Life Safety Code", 2006 Edition.
2. International Building Code, 2006 Edition, Chapter 8, Interior Finishes, Section 803.

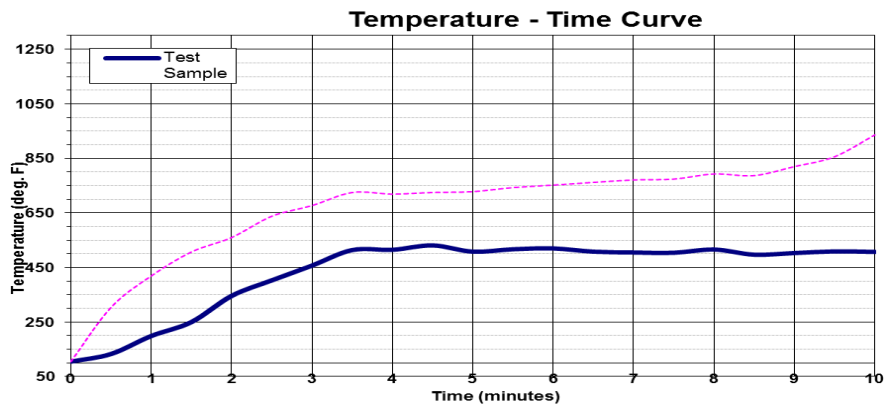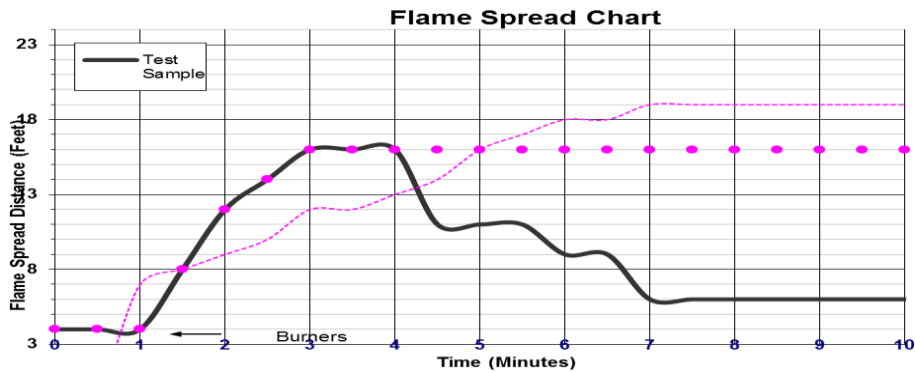

END OF REPORT

THIS REPORT IS THE CONFIDENTIAL PROPERTY OF THE CLIENT ADDRESSED. THE REPORT MAY ONLY BE REPRODUCED IN FULL. PUBLICATION OF EXTRACTS FROM THIS REPORT IS NOT PERMITTED WITHOUT WRITTEN APPROVAL FROM QAI. ANY LIABILITY ATTACHED THERETO IS LIMITED TO THE FEE CHARGED FOR THE INDIVIDUAL PROJECT FILE REFERENCED. THE RESULTS OF THIS REPORT PERTAIN ONLY TO THE SPECIFIC SAMPLE(S) EVALUATED.